



## JOB DETAILS

**JOB:** \_\_\_\_\_ **REPRESENTATIVE:** \_\_\_\_\_

**ENGINEER:** \_\_\_\_\_ **CONTRACTOR:** \_\_\_\_\_



## PRODUCT DATA

<b>MODEL NO.</b> CI1507D	<b>BacNet</b> <input checked="" type="checkbox"/> YES <input checked="" type="checkbox"/> NO	<b>MOC</b> _____	<b>MAX SUCTION</b> _____
<b>PRESSURE</b> 175 PSIG* (1210 KPA)	<b>SCCR</b> 100K	<b>BREAK TANK</b> _____	<b>BOOST PRESSURE</b> _____
<b>RPM</b> 3600	<b>ITEM NO.</b> _____	<b>VOLTAGE</b> _____	
<b>FLANGE</b> ANSI Class 125	<b>HORSEPOWER</b> _____	<b>SPLIT</b> _____	
<b>SYSTEM TYPE</b> ANSI Class 150	<b>PUMP/MOTOR</b> _____	<b>MCA</b> _____	
<b>REQUIRED SYSTEM PRESSURE</b> 250°F (120°C)	<b>RATED SUCTION PRESSURE</b> _____		

Meets ASHRAE 90.1 Qualification  
 \*In accordance with ANSI Standard B16.1 Class 125  
 NSF/ANSI/CAN 61 CERTIFIED

## DIMENSIONS

<b>PUMP MODEL</b>	CI1507D	
<b>HORSEPOWER (KW)</b>	10 (7.5)	
<b>MOTOR FRAME ODP</b>	213JM	
<b>MAX. WEIGHT LBS (KG)</b>	1942 (881)	2054 (932)
<b>FLANGE SIZE ASA</b>	6	8
<b>A</b>	10 (254)	
<b>B</b>	16.84 (428)	17.84 (453)
<b>C</b>	4.33 (110)	
<b>D</b>	13.86 (352)	
<b>E</b>	46.19 (1173)	48.59 (1234)
<b>F</b>	38.17 (970)	39.17 (995)
<b>G</b>	14.38 (365)	14.38 (365)
<b>H</b>	9.84 (250)	10.84 (275)
<b>J</b>	15.34 (390)	17.59 (447)

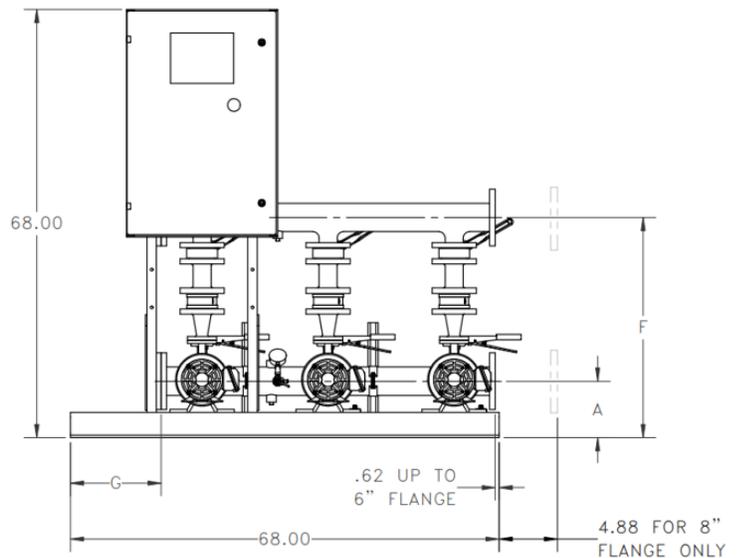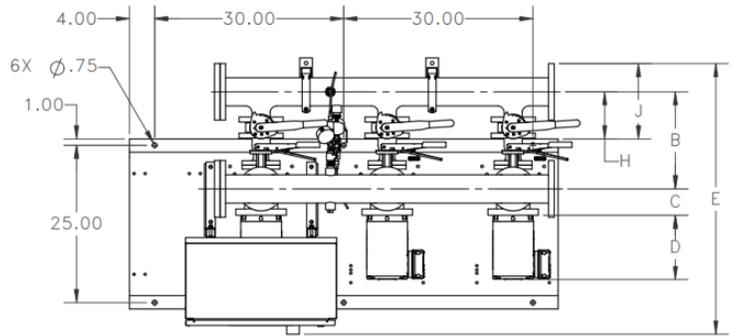



Submittal

### CI PUMP MATERIALS OF CONSTRUCTION

CASING	COVER	IMPELLER	SHAFT	SHAFT SLEEVE	MECHANICAL SEAL
Cast Iron ASTM A48/A48M-03 Class 30A	Cast Iron ASTM A48/A48M-03 Class 30A	Stainless Steel ASTM A351/A351M-08	Stainless Steel TYPE 416"™ ASTM A582	Bronze ASTM B584-98A C92200	Ceramic/EPT

NSF/ANSI/CAN 61-G & 372 CERTIFIED

### COMMENTS